



www.csiro.au

Concentrating solar power – drivers and opportunities for cost-competitive electricity

Jim Hinkley, Bryan Curtin, Jenny Hayward, Alex Wonhas (CSIRO)
Rod Boyd, Charles Grima, Amir Tadros, Ross Hall, Kevin Naicker, Adeeb Mikhail (Aurecon Australia Pty Ltd)

March 2011

Enquiries should be addressed to:
Alex Wonhas
CSIRO Energy Transformed Flagship
Phone: +61- 2-9490-5059
Email: alex.wonhas@csiro.au

Copyright and Disclaimer

© 2011 CSIRO To the extent permitted by law, all rights are reserved and no part of this publication covered by copyright may be reproduced or copied in any form or by any means except with the written permission of CSIRO.

Important Disclaimer

CSIRO advises that the information contained in this publication comprises general statements based on scientific research. The reader is advised and needs to be aware that such information may be incomplete or unable to be used in any specific situation. No reliance or actions must therefore be made on that information without seeking prior expert professional, scientific and technical advice. To the extent permitted by law, CSIRO (including its employees and consultants) excludes all liability to any person for any consequences, including but not limited to all losses, damages, costs, expenses and any other compensation, arising directly or indirectly from using this publication (in part or in whole) and any information or material contained in it.

Contents

1.	Executive summary.....	1
2.	Introduction	2
3.	CSP technologies	2
4.	Current market penetration	4
5.	Levelised cost of electricity (LCOE)	5
6.	Capital cost evaluation	6
6.1	Capital cost estimates from previous studies	7
6.2	Capital cost estimates based on “bottom-up” evaluation	8
7.	Cost trajectories – csp prices reduce with deployment	9
8.	Technology Potential.....	10
8.1	Cost reduction studies	10
8.2	Analysis of losses and opportunities	11
8.2.1	Improving the efficiency of power conversion	13
9.	Conclusions :	16
	References	18
	APPENDIX A: Capital Estimates based on “Bottom-Up” Costing	19
A.1	Methodology	19
A.2	Plant Specification	20
A.3	Component Costing	21
A.3.1	Solar Field.....	21
A.3.2	Receiver.....	21
A.3.3	Tower.....	22
A.3.4	Molten Salt and Storage Systems.....	22
A.3.5	Power Block.....	23
A.3.6	Other project costs.....	24
A.4	Overall estimated capital cost.....	25
	APPENDIX B: Thermodynamic explanation of Rankine Steam cycles	26

List of Figures

Figure 1: Solar collector technologies	3
Figure 2: Reported LCOE from various studies for projected trough and tower plants in the year 2010. Note that EPRI (2010) is for a plant commissioned in the year 2015. Sources: Turchi (2010) = (Turchi et al., 2010); S&L (2003) = (Sargent and Lundy LLC Consulting Group, 2003); NREL (2010) = (Turchi, 2010) and EPRI (2010) = (EPRI Palo Alto CA and Commonwealth of Australia, 2010)	5
Figure 3: Contribution of capital and operating costs to the levelised cost of electricity for trough and tower plants (prepared from data in (Pitz-Paal et al., 2005))	6
Figure 4: Capital cost breakdowns from literature for parabolic troughs and power towers. Prepared from data in (Pitz-Paal et al., 2005).....	7
Figure 5: CSP historical cost data vs. cumulative capacity with a fitted experience curve (Prepared from data from (Hayward et al., 2011))	10
Figure 6: Projected parabolic trough and power tower cost reductions over the current decade (Data from (Kolb et al., 2010, Kutscher et al., 2010, Turchi et al., 2010))	11
Figure 7: Energy flow diagram for a power tower CSP plant	12
Figure 8: Predicted efficiency of steam cycle for a range of commercially available steam turbines.....	14
Figure 9: Estimated LCOE for “current generation” troughs and tower for varying HTF peak temperatures.	15

List of Tables

Table 1: Current and predicted global deployment of CSP plants (sources: NREL Concentrating Solar Power Projects http://www.nrel.gov/csp/solarpaces/by_project.cfm and Wikipedia http://en.wikipedia.org/wiki/List_of_solar_thermal_power_stations)	4
Table 2: Comparison of estimated capital costs of the key areas from various studies on parabolic trough plants (Prepared from data from Ecostar (2005) = (Pitz-Paal et al., 2005) ,Turchi (2010) = (Turchi et al., 2010) and Developer (2011) = (Hinkley, 2011)).....	8
Table 3: Comparison of estimated capital costs of the key areas from various studies on power tower plants. (Prepared from data from Ecostar (2005) = (Pitz-Paal et al., 2005) and Sandia (2010) = (Gary et al., 2010)).....	8
Table 4: Estimated capital cost for a 100 MW power tower constructed in Australia.....	9
Table 5: Current and projected plant cost and LCOE for 100 MW parabolic trough plant at Longreach, Queensland (current and future unit costs based on (Turchi et al., 2010) and parabolic trough road map respectively (Kutscher et al., 2010)	16
Table 6: Current and projected plant cost and LCOE for 100 MW _e power tower with 6 hours storage at Longreach, Queensland (unit costs based on power tower road map (Kolb et al., 2010))	17

1. EXECUTIVE SUMMARY

Concentrated solar power (CSP) harnesses the sun's thermal energy to produce electricity. It has been deployed globally since the 1980's and is currently undergoing a resurgence, particularly in Spain and California, due to its inherent advantages, which are:

- Its potential to become a low cost technology and reduce its levelised cost of electricity (LCOE) from around \$225/MWh currently to \$135/MWh by 2020 (assuming the improvements identified in US roadmaps are achieved). Improvements below \$100/MWh are technically feasible by moving to novel high temperature thermodynamic cycles and new low cost approaches to field design;
- Its unique ability to be integrated with low cost thermal storage to provide renewable power well into the evening demand peak. Storage capital costs are expected to decrease from around \$90/kWh_{th} today to \$22/kWh_{th} by the end of this decade;
- Its ability to be hybridised with fossil fuels (e.g., gas or coal), which increases the dispatchability and reduces the cost of its power output;
- Its more uniform output compared to other intermittent renewable technologies;
- Its ability to exploit the advances already achieved with conventional thermodynamic cycles and power generation equipment;
- Like all solar technologies, its good match between plant output and demand profile (especially with storage);

The major drawback of CSP is its minimum efficient scale of 10-100MW_e. This creates a significant barrier for research organisations and industry to deploy and improve the technology. The technology has thus progressed less on the technology learning curve than other new energy technologies such as PV or wind.

While the vast majority (96%) of CSP plants built to date have been troughs, we show in this analysis that power towers have the potential to achieve the lowest cost in the long term because of their ability to reach higher temperatures and utilise more efficient thermodynamic cycles.

This report provides a "bottom-up" technical analysis of CSP's cost potential. This approach is much more suitable for new, early stage technologies with only a limited number of deployments to date because the traditional "top down" learning curve analysis requires many data points to provide reliable results. It is based on a review of the existing literature and our own detailed engineering analysis. It identifies where improvements can be made to CSP technology to lower costs and increase efficiency.

2. INTRODUCTION

The objective of this document is to analyse the key cost drivers of CSP and identify the technological development needed to achieve competitive electricity production costs. It is recognised that this is a capital intensive technology and improvements in electricity production costs are most likely to result from a combination of “learning through doing” to drive down capital costs and also through technological innovation and improved conversion efficiencies. Finance and risk is also a factor with these technologies due to the significant investment required for a typical CSP plant compared to other technologies such as PV which can be installed at the kW_e scale with comparatively modest project costs.

The report was prepared as input to the Garnaut Review Update in a relatively short time frame, and therefore is not intended to be comprehensive.

3. CSP TECHNOLOGIES

Nearly all of the world’s electricity, whether coal, gas or nuclear, is generated by first heating a fluid. Concentrating solar thermal power is simply another means of generating a hot fluid that can then be used downstream in conventional power generation equipment such as steam turbines. Steam turbines become more efficient with higher temperatures.

There are two basic types of concentrating collectors - those which focus the radiation along a line, and those which focus the radiation at a point. It is possible to achieve much higher concentration ratios with point focus collectors than with linear collectors, although the required optical precision is higher. However, this enables higher temperatures and the possibility to improve the efficiency of conversion of solar thermal energy into electricity. Figure 1 illustrates the principal CSP technologies.



Parabolic troughs at Kramer Junction, California
(Credit: Warren Gretz (DOE/NREL Photographic Information Exchange))



Linear Fresnel pilot plant at Liddell Power Station,
NSW Australia. (Credit: Solar Heat and Power)



The big solar dish at the Australian National University, Canberra (Credit: ANU)



PS10 Power Tower (Planta Solar 10) – near Seville in Spain (Credit: Solucar)

Figure 1: Solar collector technologies

The *Parabolic Trough Collector* is constructed by forming a sheet of reflective material into a parabolic shape that concentrates incoming sunlight onto a central tubular receiver at the focal point of the collector. A single-axis tracking mechanism is used to orient the collector toward the sun. A heat transfer fluid (HTF) is circulated through the receiver tubes to absorb the solar energy and transfer it to storage or to the power block for steam generation. Most parabolic troughs use thermal oils which become unstable above 400 °C. Parabolic troughs are the most widely-deployed CSP technology, with around 1220 MW_e operational globally.

The *Linear Fresnel Reflector* uses a field of long linear mirror strips to concentrate light on a fixed linear receiver. The mirrors are flat or elastically curved, and rotate about the receiver axis to track the sun. A small number of prototypes (about 10 MW_e) have been built and are in operation for applications ranging from medium-temperature steam production for power stations to solar thermal cooling. Proponents argue that the capital cost of a linear Fresnel plant will be less than a parabolic trough plant due to reduced structural requirements.

The *Paraboloidal Dish Concentrator* uses a frame in the shape of a parabolic dish to support curved mirrors that concentrate solar radiation onto a receiver at the focal point of the dish. This system requires the sun to be tracked in two axes, but the concentration of energy onto a single point can yield a very high concentration ratio and hence very high temperatures. Dishes have been used for pilot scale natural gas reforming, steam generation, ammonia dissociation, Brayton Cycles and Stirling engines, as well as for concentrating photovoltaics.

Power Towers (also known as *Central Receivers*) use a ground-based field of mirrors to focus solar radiation onto a receiver mounted high on a central tower. The computer-controlled mirrors, called heliostats, rotate individually about two axes, maintaining a stationary image of the sun on the receiver. Power towers permit very high concentration ratios and are well suited to large scale implementation for utility power generation. The higher temperatures afforded by power tower systems also enable a wide range of applications, such as thermochemical processes and high-temperature steam cycles for more efficient electricity generation. There are now two commercial tower plants in Spain, totalling 31 MW_e; these plants heat water to make steam at 250 to 300 °C, which is converted into electrical energy. PS10 converts around 55 MW of thermal energy into 11 MW of electrical energy. These design parameters are conservative, ensuring a successful demonstration, and it is widely accepted that future plants will achieve greater energy

conversion efficiencies utilising higher steam temperatures. A third plant to be commissioned in early 2011 will use molten salt to increase steam temperatures to around 550 °C.

The power cycle of conventional CSP plants is similar to those employed in coal fired power stations, based on a Rankine steam cycle. However, steam turbines used in solar plants are typically smaller than those used in current state of the art fossil plants (commonly 50 MW_e compared to 600 MW_e, due primarily to regulatory limits associated with feed-in tariffs). Most deployment to date has also used lower steam temperatures, up to 380 °C compared to up to 600 °C in fossil power stations due to issues with HTF stability.

Steam cycles work by expanding the high pressure steam through a turbine which converts the energy in the steam to mechanical work which drives a generator. The efficiency of these turbines is influenced by the pressure drop across the unit, which is a function of the “cold sink” temperature i.e., the temperature at which thermal energy is rejected from the system through cooling. Wet (evaporative) cooling provides the lowest temperature for the cold sink but results in a significant usage of water. Dry cooling is less efficient (by about 10%) but largely eliminates the consumption of water in the power cycle. However, this also results in increased capital cost for a given capacity and a higher electricity cost. In the Australian context, dry cooling may prove to be necessary in many locations due to the limited availability of water in areas with good solar resources.

Storage is another important consideration for a CSP plant. The current trend is for plants with upwards of 6 hours of storage (i.e., the amount of thermal energy required to operate the power block at full capacity for 6 hours). This allows plants to be less impacted by variations in solar radiation through the day, and to continue operating after the sun has set. Though there are increased capital costs associated with this ability due to the need for extra solar collectors, a larger receiver system, and of course the storage system and medium itself, these costs are offset by the extra operating hours, particularly at periods of higher tariff. Current practice is to use “solar salt”, a mixture of sodium and potassium nitrate which melts at around 220 °C and is stable to about 590 °C, although there is considerable research into new materials to extend the upper temperature limit.

4. CURRENT MARKET PENETRATION

While CSP technologies have been successfully producing electricity at utility scale since the mid 1980s, these early installations were followed by a significant hiatus in construction, with no new plants commissioned until 2006. Recent years have seen a significant acceleration in activity, as a result of favourable investment environments created by feed in tariffs and tax incentives in Spain and the US. Table 1 summarises current CSP plant deployment.

Table 1: Current and predicted global deployment of CSP plants (sources: NREL Concentrating Solar Power Projects http://www.nrel.gov/csp/solarpaces/by_project.cfm and Wikipedia http://en.wikipedia.org/wiki/List_of_solar_thermal_power_stations)

Status	# Projects	Capacity (GW)
Operational (end 2010)	39	1.27
Under construction	29	1.93
In development	67	17.53

We expect that the deployment of CSP plants will continue to accelerate thus helping drive capital costs down through “learning by doing” effects (see Section 7).

5. LEVELISED COST OF ELECTRICITY (LCOE)

The LCOE is a useful measure of the cost competitiveness of a generation technology, although when comparing values it is important to be aware of the assumptions that are embedded. For a solar plant, these may include site specific factors such as the (Direct Normal Irradiance) DNI and meteorology of a particular location, as well as more general assumptions about the life of the plant and construction period, interest rate, and capital and operating costs. In addition, the calculation methodology used to determine the LCOE can vary. Other costs can also be included or excluded, such as interest during construction, decommissioning costs, different levels of contingency, insurance, tax, adjustment factors, and financial incentives such as feed-in-tariffs etc.

Storage has a significant impact as it increases the capital cost but allows the plant to operate for longer. The optimum amount of storage depends on the relative cost of extra collectors, tanks and storage medium, but is also dependent on the revenue generated by the plant. Electricity prices are higher during the day when demand is greater and remain high into the early evening. Thus storage offers the possibility to earn higher revenue. Optimising the overall design thus becomes more complex than simply minimising LCOE, and is dependent on the market into which the electricity is sold.

A number of studies have assessed the LCOE for various CSP technologies, although there is significant scatter in the results as shown in Figure 2. It should also be noted that these assessments used widely different assumptions and different methods for calculating the LCOE and therefore a great deal of caution needs to be exercised when comparing the numbers. The only adjustment made to the reported numbers has been to convert to AUD 2010 from their original currencies. In addition, all of the studies are from the US except for EPRI (2010) which is from Australia, and this results in different costs, since materials, labour, licenses, insurance etc differ depending on the country. The large range shown for the EPRI data reflects an upper and lower estimate of costs, with the wide range being attributed to factors such as differences in DNI, the inclusion/exclusion of storage, and capital cost sensitivities.

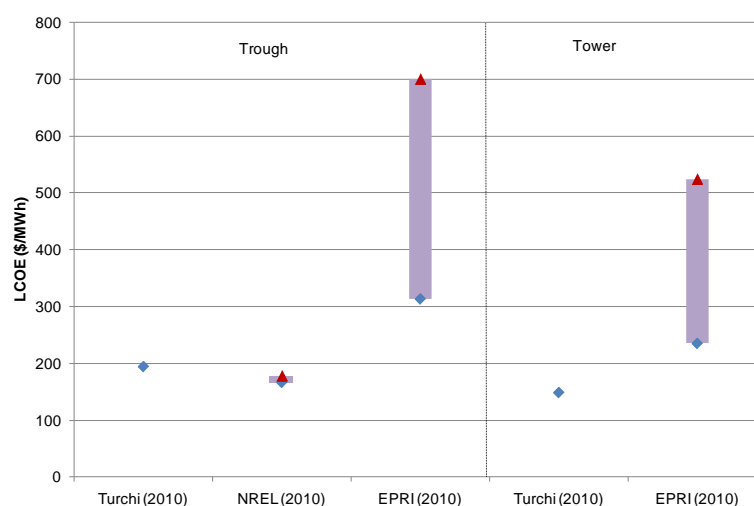


Figure 2: Reported LCOE from various studies for projected trough and tower plants in the year 2010.

Note that EPRI (2010) is for a plant commissioned in the year 2015.

Sources: Turchi (2010) = (Turchi et al., 2010); S&L (2003) = (Sargent and Lundy LLC Consulting Group, 2003); NREL (2010) = (Turchi, 2010) and EPRI (2010) = (EPRI Palo Alto CA and Commonwealth of Australia, 2010)

There are a number of prominent earlier studies which also determined the cost and potential of CSP, notably a report by Sargent and Lundy (Sargent and Lundy LLC Consulting Group, 2003) and the European Concentrated Solar Thermal Road-Mapping study ECOSTAR (Pitz-Paal et al., 2005). However, it is difficult to compare projections from these studies because key assumptions about the deployment of CSP were not realised which affects learning curve cost reductions.

Our analysis has assumed a 20 year plant life and a weighted average cost of capital of 7%.

6. CAPITAL COST EVALUATION

Previous assessments have shown that the LCOE is dominated by capital cost for the two most developed CSP technologies, towers and troughs, as shown in Figure 3. As noted, it is sometimes problematic to compare studies as there can be important differences in the assumptions. One of the key parameters is the “solar multiple”, which is the ratio of the peak thermal capacity of the field to the capacity of the power block. This is an important parameter to optimise as it determines the available thermal energy for power generation, and it is usually slightly larger than unity (1.3 or 1.4) to ensure that the power block is effectively utilised throughout the year. It is even larger if the plant has storage, generally around 2.0 for a plant with 6 hours of storage. However, oversizing the field can result in excess thermal energy that cannot be utilised, which must be dumped or avoided through defocusing of collectors. As will be discussed later, the cost of storage is one the key areas where significant progress is expected.

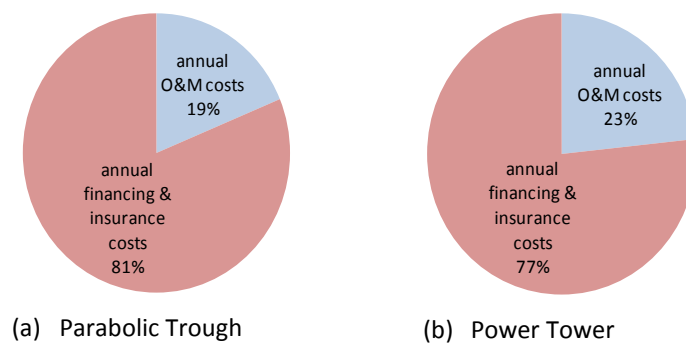


Figure 3: Contribution of capital and operating costs to the levelised cost of electricity for trough and tower plants (prepared from data in (Pitz-Paal et al., 2005))

While it is evident that CSP plants are highly capital intensive, it is difficult to find reliable cost information for CSP plants in Australia. The Solar Flagships program will result in the first large scale solar thermal power plants being built in Australia and will provide valuable insights into the cost of this technology compared to overseas. It is important to note though that the costs of first-of-a-kind plants are often significantly higher than subsequent plants as these plants involve the once-off establishment of infrastructure. Future costs will tend towards global figures (adjusted for true local factors, e.g., taxes, labour costs) once production chains have been established. In the meantime, costs must be estimated from overseas experience with CSP and insights into the relative differences between Australian and overseas project costs based on exchange rate, materials and labour variations.

6.1 Capital cost estimates from previous studies

The relative contribution of the various plant areas to the overall capital cost is shown in Figure 5. Note that while the solar field appears cheaper for towers than troughs, the field costs for troughs include the linear collector elements, whereas the analogue for a tower – the tower and receiver – has been separated out for power towers.

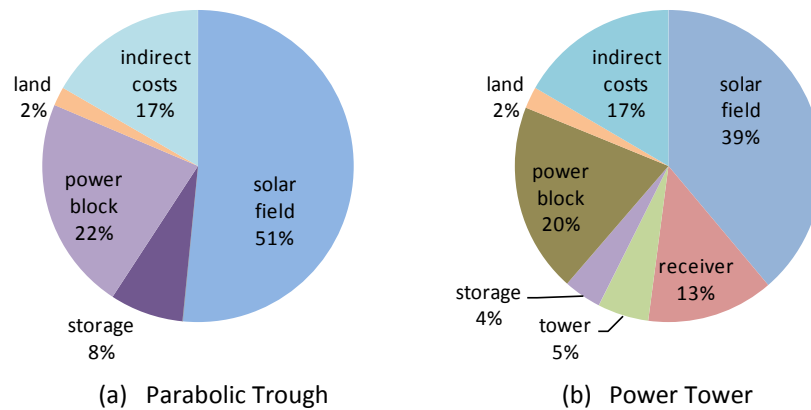


Figure 4: Capital cost breakdowns from literature for parabolic troughs and power towers. Prepared from data in (Pitz-Paal et al., 2005).

We have reviewed the available literature and found three distinct estimates of the breakdown of capital costs across the various plant areas for parabolic troughs and towers. A number of other studies exist which have based their numbers on these primary sources. The raw numbers have all been converted to AUD using the exchange rate at the year of estimation, and applying CPI inflation. The choice of year for the exchange rate calculation was made on the basis that this would most accurately reflect embodied materials costs based on global commodities such as steel.

Table 2 shows data for parabolic trough plants from two studies, as well as current prices provided by a European industry developer (Hinkley, 2011). While it should be recognised that the data in Table 2 is from different regions, and the amount of thermal storage varies, the data suggest that there has been a reduction in cost in the areas of solar collectors and power block in particular. This may well be due to the comparatively large recent deployment of solar trough plants, especially in 2009 and 2010. It should be noted that the indicative plant costs can not be directly compared as the plants have different levels of thermal storage. The operational time of a plant is expressed in terms of its capacity factor, defined as the proportion of the calendar year the plant would operate at full load to produce the annual output. Table 2 shows that increasing the amount of storage and the solar field size results in an increased capacity factor, meaning that the plant is capable of producing for significantly longer. It should also be noted that plants with storage can have significantly higher capacity factors than photovoltaics or wind generation, making CSP with storage more suitable for “base load” or dispatchable generation.

Table 2: Comparison of estimated capital costs of the key areas from various studies on parabolic trough plants
(Prepared from data from Ecostar (2005) = (Pitz-Paal et al., 2005), Turchi (2010) = (Turchi et al., 2010) and Developer (2011) = (Hinkley, 2011)).

	Ecostar (2005)	Turchi (2010)	Developer (2011)
Net Plant Size (MW_e)	50	100	50
Solar Multiple	1.4	2.0	1.3 (est.)
Capacity Factor (%)	28.5	40.0	23.0
Site Improvements (\$/m² field)	4	27	14
Solar Field (\$/m² field)	385	320	538
HTF System (\$/m² field)		98	39
Storage (\$/kWh_{th})	58	87	(79)
Power Block, BOP (\$/kW_e gross)	1327	1021	2885
Indicative Plant Cost (\$/kW_e net)	6600	8688	7501
	(3 hours storage, wet cooling)	(6 hours storage, wet cooling)	(no storage, wet cooling)

Table 3 summarises two estimates for towers with molten salt from a European and a US source. The data suggest that there has been some moderate cost reduction in the heliostat field and tower/receiver costs, although the power block costs are comparable and storage costs are higher for the more recent study. It is also interesting to note that the power block and balance of plant costs are estimated as being higher for tower plants than trough plants, despite using essentially the same technology. Storage is considerably cheaper for molten salt towers than troughs using thermal oil as the HTF because the difference between the hot and cold tanks is much greater (~280 degrees for towers compared to ~100 degrees for troughs). Note that the current commercial tower PS10 has around 0.4 hours of steam storage at an estimated \$187/kWh_{th}.

Table 3: Comparison of estimated capital costs of the key areas from various studies on power tower plants.
(Prepared from data from Ecostar (2005) = (Pitz-Paal et al., 2005) and Sandia (2010) = (Gary et al., 2010))

	Ecostar (2005)	Sandia (2010)
Net plant size (MW_e)	51	100
Solar multiple (unitless)	1.4	2.1
Capacity factor (%)	33	48
Storage (\$/kWh_{th})	24	33
Tower & Receiver (\$/kW_{th})	216	217
Solar Field (\$/m²)	266	217
Power block (\$/kW_e)	1298	1380
Indicative plant cost (\$/kW_e)	6494	8066
	(3 hrs storage, wet cooling)	(9 hours storage, wet cooling)

6.2 Capital cost estimates based on “bottom-up” evaluation

Aurecon Australia have used their considerable experience in the engineering, design and project management of pulverised coal and gas fired thermal power plants to build up estimated plant costs for a power tower plant. Aurecon’s cost estimate was based on a plant design specification developed by CSIRO for a 100 MW_e plant located in central Queensland (Longreach) using NREL’s Solar Advisor Model (SAM). SAM is a comprehensive model developed to perform techno-economic evaluations of various solar technologies, and can develop plant designs and LCOE based on climate data for a specified location. SAM models an entire CSP plant from the collector field through to the power block, and allows

the user to specify key parameters such as the per unit capital cost of different plant areas (e.g., $\$/kW_e$), the amount of thermal storage and whether the plant uses wet or dry cooling. Longreach was selected as it has a good solar resource and reasonable infrastructure connections, as well as good meteorological information for SAM.

Full details of the plant design and methodology for determining the cost estimates can be found in Appendix A. Two designs were considered, a 100 MW_e plant with and without 6 hours of thermal storage. Note that these costs are based on the “nth plant” rather than the expected cost for the construction of the first plant in Australia. These figures therefore represent what we believe is the potential capital cost of CSP in Australia based on current materials and labour prices and include up to date estimates of the power block costs. The greatest uncertainties are in the solar components, as these will require the establishment of manufacturing and supply chains which would add significantly to the cost of the first plants constructed in Australia. However, the estimates confirm that there is no reason why CSP plants cannot be constructed in Australia at prices in line or below overseas in the longer term.

Table 4: Estimated capital cost for a 100 MW power tower constructed in Australia

Equipment area	Estimated cost (A\$ million)		
	Unit Cost	No storage	With storage
Site preparation & civils	\$30 / $kW_{e,net}$	30.0	30.0
Solar Field	\$142 / m^2	101.8	143.2
Tower	\$29 / kW_{th}	11.5	14.5
Receiver	\$19 / kW_{th}	9.2	9.7
Molten Salt and Storage Systems	\$12 / kWh_{th}	12.6	20.8
Turbine systems (inc generator)	\$424 / $kW_{e,gross}$	46.0	46.6
Steam generation	\$187 / $kW_{e,gross}$	20.6	20.6
Air Cooled Condenser (ACC)	\$371 / $kW_{e,gross}$	40.8	40.8
Electrical	\$180 / $kW_{e,net}$	18.0	18.0
Controls	\$100 / $kW_{e,net}$	10.0	10.0
Fire Services	\$40 / $kW_{e,net}$	4.0	4.0
Spares (allow 5%)		15.2	17.9
Owner & contractor costs (30%)		95.9	112.9
Total Capital Cost		415.8	489.0
Indicative Plant Cost (dry cooled) $\\$/kW_e$		4158	4890

7. COST TRAJECTORIES – CSP PRICES REDUCE WITH DEPLOYMENT

Deployment is one of the most important factors in the reduction of cost for new technologies such as CSP. This is typically expressed in terms of experience curves, as shown in Figure 5. The calculated learning rate over all CSP installations to date is a 15% reduction per doubling of cumulative deployment. It reflects cost savings from both economies of scale in manufacturing and technical innovation. Given the small number installations and the stop start deployment of CSP plants, the error bar on this figure is expected to be significant. More established renewables have demonstrated comparable learning rates, e.g., 20% for photovoltaics and 15% for wind (Hayward et al., 2011).

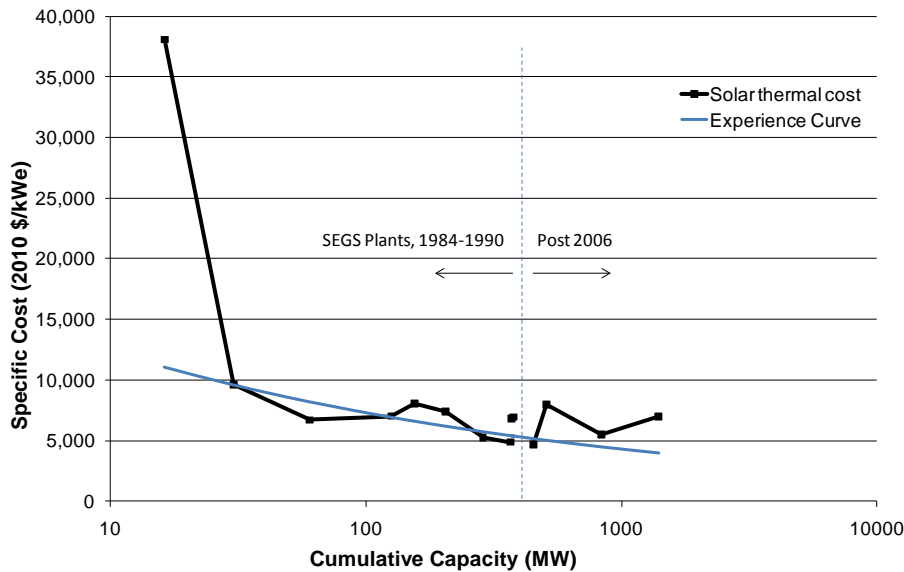


Figure 5: CSP historical cost data vs. cumulative capacity with a fitted experience curve
(Prepared from data from (Hayward et al., 2011))

8. TECHNOLOGY POTENTIAL

Because the learning rate methodology discussed in the previous section has limitations for early stage technologies, we will now analyse the potential for LCOE reduction based on a technological analysis. We find the LCOE can be reduced from the current \$225/MWh to around \$135/MWh by 2020 through a combination of reduced capital cost through learning, and improving conversion efficiency by moving to higher temperature cycles and eliminating key losses.

8.1 Cost reduction studies

The United States Department of Energy (DOE) has commissioned two recent studies to determine the technical potential for reducing the cost of electricity from CSP – the Line-Focus Solar Power Plant Cost Reduction Plan (Turchi et al., 2010) and the Power Tower Technology Roadmap and Cost Reduction Plan (Kolb et al., 2010). Both these studies concluded that significant reductions in cost were possible through a combination of mass manufacturing and technological improvement and innovation. Figure 6 shows the expected reductions achievable by 2020 for tower plants, and 2017 for trough plants. The height of the bars represents the contributions of the various plant areas to the overall cost, based on a SAM plant simulation for a 100 MW plant located at Longreach in Queensland. This baseline plant has 6 hours of storage and uses dry cooling. Also shown at the top of the columns are the O&M costs (in \$/kW.yr), which are likewise projected to decrease significantly.

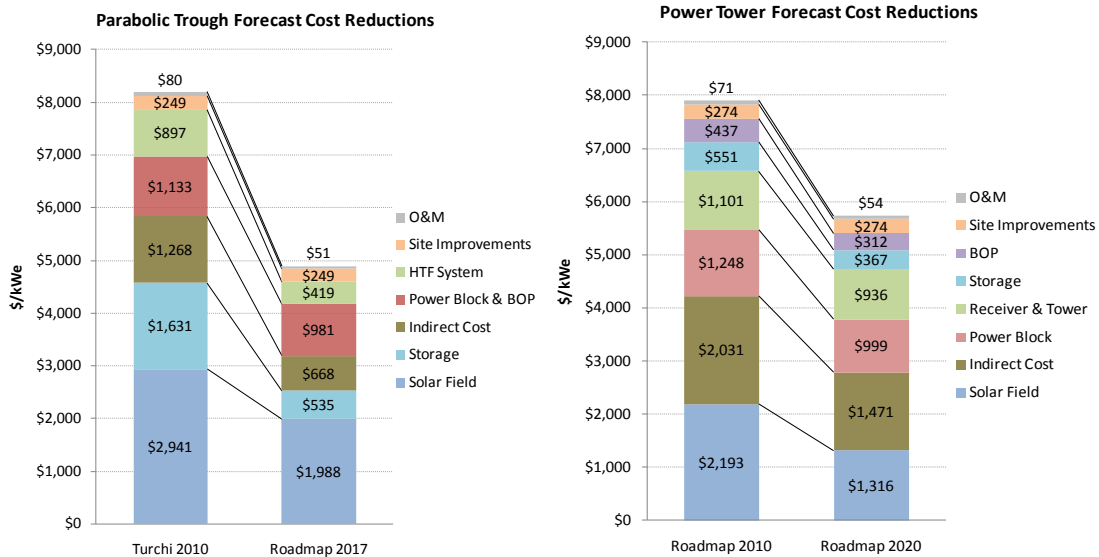


Figure 6: Projected parabolic trough and power tower cost reductions over the current decade (Data from (Kolb et al., 2010, Kutscher et al., 2010, Turchi et al., 2010))

For troughs, significant reductions are expected in most areas, especially for thermal storage and the HTF system. This is expected to result from operating troughs at higher temperatures; increasing the difference between the hot and cold fluid temperatures for both the HTF and storage medium reduces HTF pumping requirements and also the capacity and cost of the thermal storage system. Across the board, the various cost reductions are expected to translate to a 41% reduction in capital cost for our generic plant.

For towers, the greatest leverage is expected in the cost of the solar field, which is predicted to fall by 40%. This is consistent with the ground up cost estimates provided by Aurecon. It is interesting to note that the indirect costs associated with towers, representing the EPC (engineer, procure, construct) project management costs and contingencies, are almost twice those for troughs. This may be a reflection on the different perspectives of the two groups preparing the studies or a consequence of the lower maturity of tower technology. The overall reduction in capital cost projected for our generic plant is around 28%.

8.2 Analysis of losses and opportunities

SAM models the energy flows in a CSP plant by determining the losses in each subsystem of the overall plant. Figure 7 shows annual average data from SAM for a tower plant with 6 hours storage. The plot shows how the net electrical output of the plant is related to the potential incident solar energy, and where the key loss areas are in between. Note that this plot consists of a mixture of types of energy, shown in separate colours. Note also that this is not a thermodynamic efficiency, but simply a chart identifying where the major energy flows are. A CSP plant will have a significantly better instantaneous efficiency at the design point when all the subsystems are operating at their peak efficiencies.

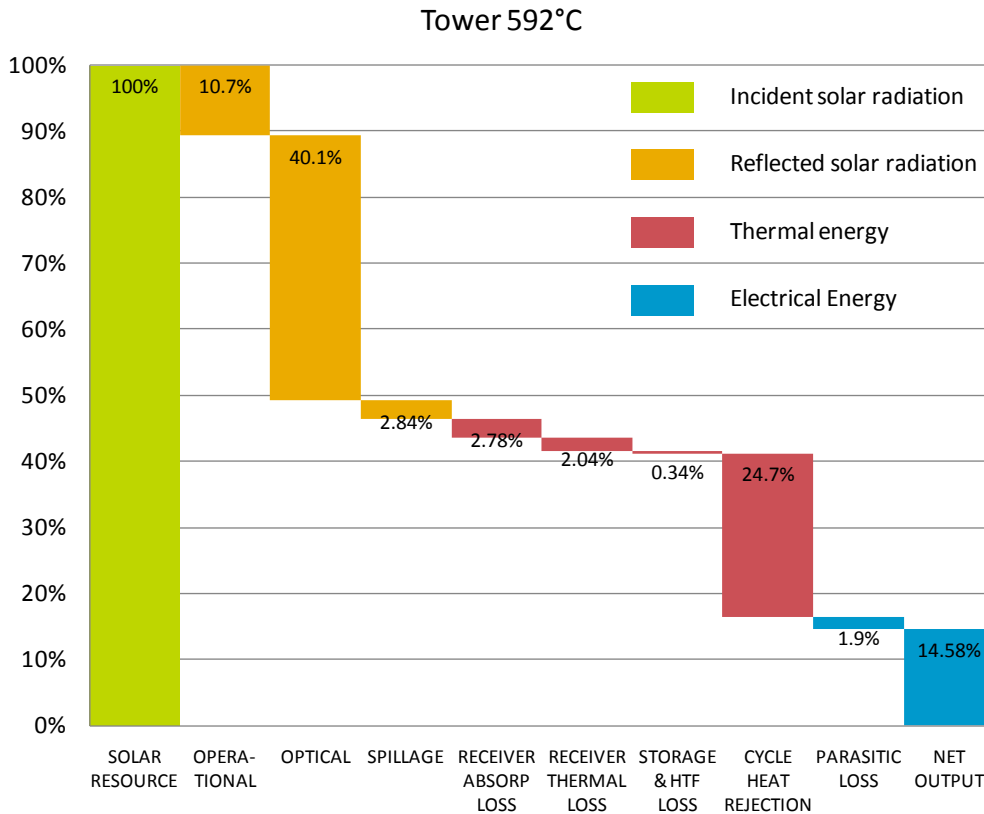


Figure 7: Energy flow diagram for a power tower CSP plant

The components of the energy diagram are as follows:

- **Solar Resource** represents the theoretical amount of energy available, and is the product of the solar radiation on a surface normal to the sun (Direct Normal Irradiance or DNI) and the total mirror area. This is an annual average calculation.
- **Operational** represents the energy that is not collected due to non-utilisation of the solar field from mechanical unavailability of the overall plant, as well as times when the power cycle is fully loaded and additional thermal energy is not required (in times of peak DNI), and energy is not collected or utilized through defocusing or dumping.
- **Optical** represents the amount of energy that is lost due to geometric factors and imperfect reflection of the available energy. It includes effects from cosine losses, reflectance, soiling, shading and blocking and from atmospheric attenuation. Cosine losses are the geometric losses that result from the relative position of the sun, heliostat and receiver (because the heliostat directs energy onto the receiver rather than pointing directly at the sun). There are also losses due to shading and blocking of the heliostats. These losses together total about 20% of the theoretically possible energy but in reality cannot be eliminated. Reflectance refers to the losses due to the reflectivity of the mirror surface – even high performance low iron glass mirrors have a maximum reflectivity of about 96%. Soiling refers to losses in reflectivity due to dust and dirt on the mirror surface. Some energy is also lost due to atmospheric attenuation; this is also dependent on the distance between heliostat and receiver.
- **Spillage** represents the proportion of the reflected energy that is not incident on the receiver surface due to mirror quality or errors in positioning.
- **Receiver absorption losses** refer to the amount of energy that is reflected by the receiver surfaces. Even high absorption coatings typically have a maximum absorbance of 94% i.e., 94% of the incident concentrated solar radiation is converted to thermal energy.

- **Receiver Thermal Losses** represent the thermal losses from the receiver due to convection and radiation losses.
- **Storage & HTF Loss** represents the amount of thermal energy that is lost from piping and thermal storage systems. These losses are normally very low due to insulation.
- **Cycle heat rejection** refers to the thermal energy that the power cycle is not able to convert to electricity, which is rejected as waste heat in the cooling system. This is discussed in more detail below.
- **Parasitic Loss** refers to the energy consumed by the plant itself to produce electricity, and consists primarily of the electrical requirement for HTF pumping along with energy used for control of the positioning of the heliostats (minor). The parasitic loss is typically around 5-10% of the gross electrical output of the plant depending on the level of storage. It may be possible to reduce these losses as in conventional fossil plants through the use of steam driven rather than electric pumps.
- **Net Output** is the electricity produced by the plant, after all internal losses have been accounted for.

Figure 7 suggests that the priority areas for improvement are the reduction of optical losses and the cycle heat rejection. The bulk of the optical “losses” are in fact a function of geometry and the movement of the sun through the day, which can not be eliminated. It is certainly possible to optimise the field layout to minimise the amount of shading and blocking with existing design tools. Likewise, it is widely recognised that the reflectance is a key parameter, and there is little room for improvement on the performance of current materials, although there is some interest in developing surface coatings to prevent dust adhesion and minimise water consumption for cleaning. The major areas of work relating to the optics of towers are around improving the precision of the heliostats, and reducing their capital cost.

The other major area of energy loss is in the power cycle, and there are a number of options for improving performance in this area.

8.2.1 Improving the efficiency of power conversion

The maximum steam temperature in the power cycle is the primary driver of the theoretical power that can be extracted from the thermal energy in a CSP plant. The maximum amount of work that can be done using a heat engine is expressed by the Carnot efficiency:

$$\eta = 1 - \frac{T_c}{T_h}$$

Where η is the efficiency, T_c the absolute temperature of the cold sink and T_h the absolute temperature of the hot fluid. This equation defines the thermodynamic upper limit for the efficiency of a heat engine; a real cycle based on steam has other losses and inefficiencies and will reach about two thirds of the Carnot cycle efficiency. The real cycle used in steam power plants is the Rankine cycle (see Appendix B). The efficiency of the Rankine cycle depends on the average temperature at which heat is supplied and the average temperature at which heat is rejected. Any changes that increase the temperature that is supplied or decrease the average temperature that is rejected will increase the Rankine cycle efficiency.

As noted earlier, CSP plants have typically utilised much lower steam temperatures and pressure than current industry practice for pulverised coal plants. Parabolic trough plants have been limited by the decomposition temperature of the thermal oil used as the heat transfer fluid to temperatures less than 390 °C, although a 5 MW_e demonstration plant has recently been constructed in Sicily using molten salt as the HTF, reaching an outlet temperature of 550 °C from the solar field (NREL, 2011), Similarly, the two operating power

tower plants (PS10 and PS20) have used rather conservative steam conditions of 250-300 °C (ibid), as they are the first of their type. However, a third plant being commissioned in 2011, Gemasolar, will use molten salt in the receiver to attain an outlet temperature of 565 °C (ibid). It is generally accepted that increasing the temperature at which steam can be generated will result in significant improvements in efficiency and reduction in the LCOE. We will now explore this premise based on data from SAM modelling, our harmonised cost data presented previously, and data for commercially available steam turbines.

Figure 8 shows the efficiency of a Rankine steam cycle predicted by thermodynamic calculations using available specifications for individual commercial steam turbines. Efficiency of conversion of thermal energy to electricity improves significantly as the steam temperature increases, although there is some scatter evident due to variations in other operating conditions, notably pressure and turbine size.

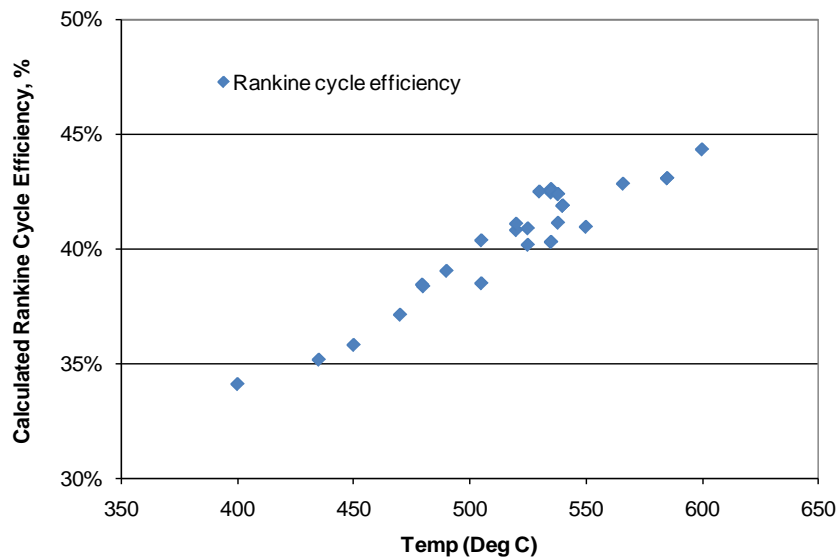


Figure 8: Predicted efficiency of steam cycle for a range of commercially available steam turbines.

Another advantage of increasing the HTF peak temperature, and hence the difference between the hot and cold fluid temperatures, is the reduction in volume of HTF that needs to be circulated in the plant, and also the volume of storage required. This not only results in a significant reduction in the pump power required to circulate the HTF, but also a significant reduction in the capital cost of the storage system.

However, higher temperatures also increase receiver thermal losses, as re-radiation is proportional to the fourth power of temperature and thus increases relatively quickly with increasing temperature. To investigate the impact of these trade-offs on the overall solar to electric efficiency, a system model was constructed based on data from SAM to investigate how the efficiency of the plant areas identified in Figure 7 varied with temperature. The overall system efficiency could thus be expressed as the product of the subsystem efficiencies. A number of other assumptions needed to be made to enable the investigation:

- Optical efficiency & receiver absorption: assumed to be constant;
- Receiver re-radiation losses: modelled using the Stefan-Boltzmann law using constant concentration ratio for each technology (82 for troughs and 734 for towers).

- Convective losses assumed to increase linearly with temperature, based on a temperature difference of 80° between tower receiver surface and HTF. For troughs, difference of 330° between collector tube and outside of glass (i.e., 60° C at design point)
- HTF has a minimum working temperature of 290 °C
- Power block efficiency: modelled using data from Figure 8
- Parasitic losses: assumed proportional to HTF temperature difference and amount of HTF to be circulated
- Project risk was assumed to be the same (18.5% contingency) for towers and trough plants
- Power block costs were assumed to be the same (\$1021 /kW_e) for towers and trough plants

The plant was resized based on the overall efficiency by adjusting the size of the solar field, tower, receiver and power block to give the same net output of electricity. Note that the minimum working temperature of the HTF causes an asymptotic increase in the LCOE at lower temperatures due to lower overall efficiencies, which increases capital costs due to increases in the collector area required. This is a consequence of both increases in HTF pumping requirements and decreased efficiency in the power cycle.

We then determined the LCOE for each scenario, based on a constant capacity factor and capital estimates using the harmonised cost data above, as shown in Figure 9.

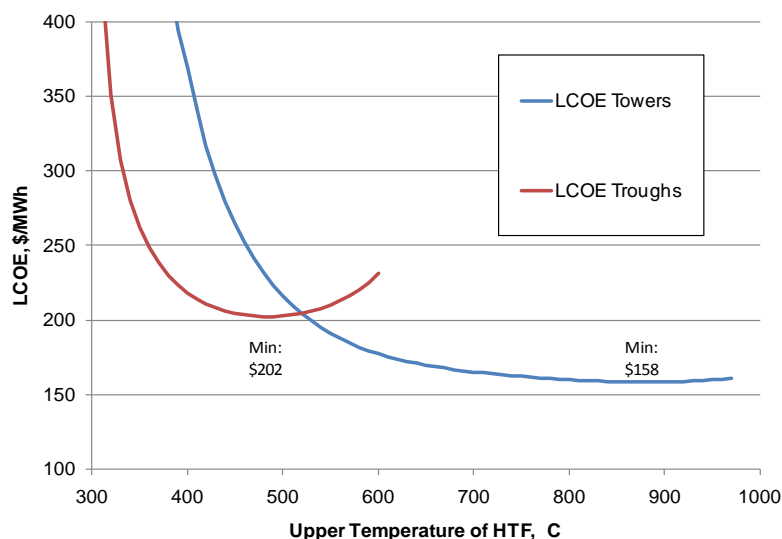


Figure 9: Estimated LCOE for “current generation” troughs and tower for varying HTF peak temperatures.

The results indicate that LCOE generally decreases as the HTF temperature increases, although trough systems have a minimum around 490 °C beyond which thermal losses become too severe and the LCOE increases again. This is less of an issue for towers, because the higher optical concentration results in a smaller area for re-radiation. Towers do not have such a well defined minimum LCOE; while the LCOE continues decrease up to around 890 °C, the rate of reduction slows with increasing temperature. Note that this is a simplified analysis. In practice, a number of other factors must be considered including the stability of the HTF itself (beyond 600 °C), the ability of the receiver materials to withstand high temperatures especially in hot spots, and finding an appropriate power conversion cycle. If these requirements can be met, further decreases in LCOE of 10 % may be possible at a temperature of 750°C for example.

9. CONCLUSIONS:

Table 5 summarises the current and projected costs for a trough plant based on the harmonised costing presented earlier, again for the reference location at Longreach in Queensland (6 hours storage, dry cooled). SAM was used to estimate the requisite field area and yield of electricity, assuming an overall availability of 94%. The LCOE was then estimated based on a conservative 20 year plant life and a weighted average cost of capital of 7%. The LCOE decreases by 13% if a 30 year plant life is assumed.

Also shown are the expected cost reductions based on the NREL road mapping exercise; this translates to a reduction of 40% in LCOE from around \$223 to \$135/MWh by 2017. This roadmap included a wide range of cost reduction and process improvement initiatives with a goal of attaining a DOE target of 100 USD/MWh when an investment tax credit of 10% was included. Molten salt as the HTF and higher operating temperatures were also considered as longer term options, and this could result in a further 10-15% reduction in LCOE as shown in Figure 9.

Table 5: Current and projected plant cost and LCOE for 100 MW parabolic trough plant at Longreach, Queensland (current and future unit costs based on (Turchi et al., 2010) and parabolic trough road map respectively (Kutscher et al., 2010)

All costs in AUD 2010	Current Cost	Future Cost (2017)	Reference plant sizing	Current Capital Cost	Future Capital Cost (2017)
Site Improvements (\$/m²)	27	27	918,026 m ²	\$24,786,702	\$24,786,702
Solar Field (\$/m²)	320	217	918,026 m ²	\$293,768,320	\$199,211,642
HTF System (\$/m²)	98	46	918,026 m ²	\$89,966,548	\$42,229,196
Storage (\$/kWh_{th})	87	29	1,877,110 kWh _{th}	\$163,308,570	\$54,436,190
Power Block, BOP (\$/kW_e gross)	1021	884	111,000 kW _e	\$113,331,000	\$98,124,000
Indirect Cost	18.5%	16%		\$126,754,811	\$70,334,032
Indicative Cost (\$/kW_e net)				\$8,119	\$4,891
O&M (\$/kW-yr)	80	51	100 MW _{net}	\$7,980,000	\$5,130,000
Solar Multiple			2.0		
Storage Hours			6		
Capacity Factor (%)			43.2%		
LCOE (\$/MWh) (20 yr life, WACC 7%)				\$223	\$135

Table 6 summarises the current and projected costs for a tower plant based on the current costs presented earlier, for the same reference location. Again, SAM was used to determine the approximate field area and plant sizing to produce a net output of 100 MW_e at the reference site of Longreach (6 hours storage, dry cooling). Also shown are the expected cost reductions based on the Sandia road mapping exercise (Kolb et al., 2010) and how this translates to a reduction of 28% in LCOE from around \$226 to \$164/MWh by 2020. Again, a further reduction of 10-15% can be foreseen if suitable materials can be found to push the receiver and HTF temperatures beyond the limits imposed by molten salt, as indicated in Figure 9, to around \$140/MWh.

Table 6: Current and projected plant cost and LCOE for 100 MW_e power tower with 6 hours storage at Longreach, Queensland (unit costs based on power tower road map (Kolb et al., 2010))

All costs in AUD 2010	Current Cost	Future Cost (2020)	Generic plant sizing	Current Capital Cost	Future Capital Cost (2020)
Site Improvements (\$/m²)	27	27	1,010,046 m ²	\$27,422,752	\$27,422,752
Solar Field (\$/m²)	217	130	1,010,046 m ²	\$219,382,013	\$131,629,208
Receiver & Tower (\$/kW_{th})	217	185	507,353 kW _{th}	\$110,197,072	\$93,667,511
Storage (\$/kWh_{th})	33	22	1,691,180 kWh _{th}	\$55,098,644	\$36,732,430
Power Block (\$/kW_e gross)	1086	869	115,000 kW _e	\$124,890,000	\$99,912,000
BOP (\$/kW_e gross)	380	272	115,000 kW _e	\$43,711,500	\$31,222,500
Indirect Cost			35%	\$203,245,693	\$147,205,240
Indicative Cost (\$/kW_e net)				\$7,836	\$5,675
O&M (\$/kW-yr)	71	54	100.05 MW _{net}	\$7,062,530	\$5,432,715
Solar Multiple			1.8		
Storage Hours			6		
Capacity Factor (%)			40.9		
LCOE (\$/MWh) (20 yr life, WACC 7%)				\$226	\$164

In summary, the LCOE for both trough and tower plants is expected to fall significantly by 2020. Decreases are likely to be greatest for trough plants, primarily due to deployment, because they are the most mature CSP technology and will continue to be chosen in many cases on the basis of risk. Power towers are also likely to see substantial decreases in LCOE costs, and indeed have the potential for achieving the lowest LCOE of the two CSP technologies in the longer term due to the higher conversion efficiencies and simplified thermal storage.

It should finally be noted that the analysis here is largely based on US and European costs and studies, and initial installations in Australia are likely to be more expensive due to unfamiliarity with the technology and the need to establish supply and manufacturing chains. However, the ground up cost analysis provided by Aurecon clearly shows there is no technical barrier that will prevent Australian manufacturers from matching or bettering best practice CSP plant costs overseas.

REFERENCES

- EPRI PALO ALTO CA & COMMONWEALTH OF AUSTRALIA (2010) Australian Electricity Generation Technology Costs - Reference Case 2010. IN BOORAS, G. (Ed., Prepared for Department of Resources, Energy and Tourism.
- GARY, J. A., CLIFFORD, K. H., MANCINI, T. R., KOLB, G. J., SIEGEL, N. P. & IVERSON, B. D. (2010) Development of a power tower technology roadmap for DOE. *SolarPaces*. Perpignan, France.
- HAYWARD, J. A., GRAHAM, P. W. & CAMPBELL, P. K. (2011) Projections of the future costs of electricity generation technologies: an application of CSIRO's Global and Local Learning Model (GALLM). CSIRO.
- HINKLEY, J. (2011) Confidential industry personal communication.
- KOLB, G. J., HO, C. K., MANCINI, T. R. & GARY, J. A. (2010) Power tower technology roadmap and cost reduction plan. Sandia National Laboratories (Draft, Version 18, December 2010).
- KUTSCHER, C., MEHOS, M., TURCHI, C. & GLATZMAIER, G. (2010) Line-focus solar power plant cost reduction plan. NREL and Sandia.
- NREL (2011) Concentrating solar power projects by project name. Golden, Colorado, NREL National Renewable Energy Laboratory.
- PITZ-PAAL, R., DERSCH, J. & MILOW, B. (2005) ECOSTAR: European Concentrated Solar Thermal Road-Mapping. DLR.
- SARGENT AND LUNDY LLC CONSULTING GROUP (2003) Assessment of parabolic trough and power tower solar technology cost and performance forecasts. Chicago, Illinois, USA, NREL.
- TURCHI, C. (2010) Parabolic trough reference plant for cost modeling with the Solar Advisor Model (SAM). Golden, Colorado, NREL.
- TURCHI, C., MEHOS, M., HO, C. K. & KOLB, G. J. (2010) Current and future costs for parabolic trough and power tower systems in the US market. *SolarPACES 2010*. Perpignan, France

APPENDIX A: CAPITAL ESTIMATES BASED ON “BOTTOM-UP” COSTING

Aurecon Australia used their considerable experience in the engineering, design and project management of pulverised coal and gas fired thermal power plants to build up plant cost estimates for CSP plants. CSIRO and Aurecon have developed a process design for a 100 MW plant located in central Queensland (Longreach) using power tower technology, and Aurecon have provided a cost estimate.

A.1 Methodology

Component costs for the 100 MW plant have been estimated using a “bottom-up” approach. To achieve this, the plant was divided into 4 main areas:

- Solar Field
- Receiver & Tower
- Storage and molten salt system
- Power Block

Within each area, approximately 10 equipment items or systems were identified for detailed costing. Depending on the particular equipment, one of the following methods was used to estimate its fabrication and installation cost. In most cases an alternative method was used for verification. The methods include:

- a) Obtain budget estimates from suppliers: A number of the plant components are standard items used in a variety of different industrial and power generation processes. Prices were obtained from local suppliers for items of this type. Examples include pumps, fans and piping.
- b) Reference to Aurecon equipment cost database: A number of equipment items are used in other power generation technologies and are familiar to Aurecon. For these items, our equipment capital cost database of actual tendered prices was used for reference. Where necessary engineering log law scaling factors and price escalation rates were applied to convert historical prices for plant of different throughput or rating to 2011 estimates. Examples of items costed in this way include the fossil backup boiler and salt-steam heat exchangers
- c) Cost scaled from pilot plant actual cost: For certain plant areas where the only known data is pilot plant cost information, the pilot plant values were scaled to full size. A risk associated with this approach is that benefits due to economies of scale and technology learning are not considered. The solar field was costed using this method.
- d) Using estimated material and labour cost: For certain equipment items there was no precedent or scalable cost data. In these instances, an approach was adopted that

included estimation of materials types and quantities (e.g., concrete and mild steel) as well as labour hours and rates. The Rawlinsons Construction Cost Guide 2011 was used for estimates of most materials and labour rates. Plant areas that were costed using this approach included the HTF storage tanks, tower and receiver.

- e) Based on power generation design package (Thermoflex) estimate: The Thermoflex software¹ has a built in capital cost estimation feature which has been found by Aurecon to yield excellent agreement to actual plant costs for gas turbine power plants. The software was used for the power block cost estimates as well as steam generator component pricing.

A.2 Plant Specification

The overall plant specification was developed by CSIRO using SAM. Two options were considered:

- A plant with 6 hours thermal energy storage
- A plant with no energy storage

The main design features of the options are summarised in Table A.1.

Table A.1: Nominal Plant Specification

	No storage	Storage
Plant capacity	100 MW (sent out)	
Storage	nil	6 hours
Plant location	Longreach (Queensland)	
Solar Field	Heliostats: 4974, each 12.2 m x 12.2 m Total field area: 718,120 m ² aperture	Heliostats: 6996, each 12.2 m x 12.2 m Total field area: 1,010,046 m ² aperture
Working fluid	HTF (60% NaNO ₃ , 40% KNO ₃) Hot temperature: 574 °C Cold temperature: 290 °C	
Receiver	Cylindrical, 24 panels. Height: 15.7 m Diameter: 10.67 m Receiver Area: 508.5 m ²	Cylindrical, 24 panels. Height: 18.49 m Diameter: 11.56 m Receiver Area: 671.5 m ²
Tower	166.67 m high	205.56 m high
Power Block	Turbo-generator net output: 100 MW _e Turbine steam conditions: 539 °C / 16.5 MPa	
Cooling System	Dry cooled Air cooled condenser	
Land area	963 acres	1284 acres

A number of assumptions were made in estimating costs:

- Equipment was assumed to be of OECD manufacture.
- All prices in 2011 Australian dollars

¹ <http://www.thermoflow.com/>

A.3 Component Costing

The following sections describe the approach used for the cost estimation of each plant area.

A.3.1 Solar Field

The cost estimation for a 100MW CSP plant was based on solar fields of 1,010,046 m² (storage) and 718,120m² (no storage), which will require 6996 and 4974 heliostats respectively. Each heliostat has a reflecting surface just over 144 m². The heliostat mirrors design consists of glass mirrors and steel structure supported on concrete foundations. Each heliostat will require motors and tracking systems and field wiring to control and track the sun and concentrating the solar radiation on the receiver.

Costing was based on a combination of literature review and bottom up pricing. Number of studies^{2 3,4 5 6 7 8 9 10} were reviewed for heliostat pricing in \$/m² and material quantities per heliostat. Materials included kilograms of glass, steel and concrete as well as actuators and field wiring. The review and bottom up approach concluded that \$140/m² is an appropriate estimate of heliostat fabrication and erection cost.

A.3.2 Receiver

The receiver is assumed to be of external design with 24 adjacent panels arranged around the perimeter of a 12.44 m diameter tower structure. Each panel is 19.91 m high and comprises of 40 individual 0.04 m OD tube joining to a common header at either end. Several flow arrangements have been proposed [2008, Wagner]¹¹ and for this study a north south flow with east west cross over has been assumed.

Costing the receiver assumed two pipe sizes, 40 mm for the parallel panel runs and 150 mm at the headers and inter-panel connections to maintain the flow rate. All components are to be fashioned from commercially available schedule 5, 316 Stainless Steel tubing. From the outlined dimensions above and an average labour cost of \$250/hr for persons competent in

² SARGENT AND LUNDY LLC CONSULTING GROUP (2003) Assessment of parabolic trough and power tower solar technology cost and performance forecasts. Chicago, Illinois, USA, NREL.

³ Kolb, G.J., Ho, C.K., Mancini, T.R., and Gary, J.A., 2010, Power Tower Technology Roadmap and Cost Reduction Plan, Sandia National Laboratories, Albuquerque, NM

⁴ Arthur D. Little, Inc., June 2001, Heliostat Cost Review.

⁵ Enermodal Engineering Limited, 1999, Cost Reduction Study for Solar Thermal Power Plants, prepared for the World Bank.

⁶ Science Applications, Inc., 1987, Development of the Stressed-Membrane Heliostat Mirror Module Final Report, SAND87-8179. Sandia National Laboratories, Albuquerque, NM.

⁷ Mavis, C. L., 1989, A Description and Assessment of Heliostat Technology, SAND87-8025, Sandia National Laboratories, Albuquerque, NM.

⁸ Kolb, G.J., Jones, S.A., Donnelly, M.W., Gorman, D., Thomas, R., Davenport, R. and Lumia,R., 2007, Heliostat Cost Reduction Study, Sandia National Laboratories, Albuquerque, NM.

⁹ Beniga, K., et al., 1989, An Improved Design for Stretched-Membrane Heliostats, Science Applications International Corporation, SAND89-7027. Sandia National Laboratories, Albuquerque, NM.

Ortega, J.I., Burgaleta, J.I., Tellez, F.M., 2006, Central receiver system (CRS) solar power plant using molten salt as heat transfer fluid. SENER / CIEMAT publication, Madrid, Spain.

¹⁰ Ortega, J.I., Burgaleta, J.I., Tellez, F.M., 2006, Central receiver system (CRS) solar power plant using molten salt as heat transfer fluid. SENER / CIEMAT publication, Madrid, Spain.

¹¹ Wagner, M J 2008, Simulation and Predictive Performance Modelling of Utility-Scale Central Receiver System Power Plants, MS (Mech. Eng.), University of Wisconsin - Madison.

pressure welding, the cost of fabrication and installation has been determined as shown in Table A.2.

Table A.2: Receiver costing details

Panels	
Total length (OD 40mm)	19453 m
Unit Cost	\$19.13 /m
Time for Labour	0.41 hr/m
Time for Labour (Joining to Header)	1 hr/tube
Subtotal	\$2,854,561
Headers and Inter-panel Connection	
Total length (OD 150mm)	142 m
Cost (OD 150mm; Shed 5; SS316)	\$61.49 /m
Time for Labour	0.89 hr/m
Subtotal	\$40,362
Design, Fabrication and Installation	
Engineering Design	\$1,500,000
Transportation to Site	\$700,000
Assembly Labour	\$4,000,000
Crane Hire	\$1,000,000
Total	\$10,094,922

A.3.3 Tower

A set of civil and structural conceptual designs were developed to enable accurate solar tower cost estimates. This cost is based on a concrete tower shell design with a total height of 205 m (storage case) and 167 m (no storage). Included are all associated civil/structural requirements such as piling, footing, excavation and refill. A steel platform floor was assumed to support receiver rather than a concrete slab to reduce weight. Also a lift, ladders and landing were all included in the price estimate.

A.3.4 Molten Salt and Storage Systems

Depending on the specific storage and operational requirements, a concentrated solar power plant requires at least one Heat Transfer Fluid (HTF) tank for cold molten salt and a second hot tank should storage be required. For this study the variation in tank requirements for each case forms the basis for the difference in capital cost. In the no storage case, HTF is pumped up the tower where it is heated before descending the tower to the steam generator and returned to the cold storage tank. When storage is required, an amount of the descending hot HTF is directed into a hot storage tank for later use.

Using the foundation design described in the NREL¹² a bottom up cost has been developed for both scenarios. In each case the storage was broken up into three main areas namely; tanks, foundations and steam heating. Figures from the aforementioned NREL² report, a life

¹² Kelly, B Kearney, D 2004, *Thermal storage commercial plant design for a 2-tank indirect molten salt system – final report*, Subcontract Report NREL/SR-550-40166 July 2006.

cycle assessment of thermal storage¹³ and internal experience with the Australian construction industry have been combined to formulate this capital cost estimate.

Both the hot and cold tanks have a capacity of 7.5 ML with a diameter of 21.92 m and height of 20 m. Table A.3 outlines the cost break down for the tanks and tank foundations. The Hot Tank (HT) requires an additional insulating fire brick layer that the Cold Tank (CT) does not.

Table A.3: Details of cost estimation for hot and cold molten salt tanks

Materials	Quantity	Unit	Value	Unit	Cost
Calcium Silicate (H&CT)	3,510.9	m ²	297.7	\$/m ²	\$1,045,166
Steel (H&CT)	1,414,874	kg	5.57	\$/kg	\$7,886,210
Concrete (H&CT)	686	m ³	1000	\$/m ³	\$685,777
Foam Glass Volume (HT)	103	m ³	450.97	\$/m ³	\$46,540
Foam Glass Volume (CT)	138	m ³	450.97	\$/m ³	\$62,053
Refractory Brick (HT)	49	m ³	1000	\$/m ³	\$49,146
Refractory Brick (CT)	42	m ³	1000	\$/m ³	\$42,276
Firebrick Volume (HT)	2,952	Bricks	1.27	\$/brick	\$3,739
Firebrick Labour (HT)	2,952	Bricks	2	\$/brick	\$5,904
Insulating Concrete (HT)	109	m ³	1100	\$/m ³	\$119,435
Steel Slip Plate Weight (H&CT)	35,530	kg	1.65	\$/kg	\$58,511
Steel Slip Plate Labour (H&CT)	0.022	hr/kg	70	\$/hr	\$54,716
Total					\$10,059,473

The costs of system components common to both scenarios is substantial and it is interesting to note that the differential between the storage and no storage cases is not as great as might be expected (see Table A.4).

A.3.5 Power Block

The power block design consists of a conventional steam cycle. Steam is raised and superheated by the heat transfer fluid (HTF) via a number of shell and tube heat exchangers. The steam drives a single reheat turbine with air cooled condenser (ACC). The turbine consists of two cylinders with single flow high pressure turbine (HPT) and combined opposed single flow intermediate pressure (IPT) and low pressure turbines (LPT). A single bled steam open feedwater heater is employed as well as a HTF feedwater pre-heater. The feedwater pre-heater is again a shell and tube type.

The key design parameters are:

Site conditions:	25 °C, 60% RH, 111 m altitude
Turbo-generator net output:	100 MWe
Steam temperature at turbine:	539 °C
Steam pressure at turbine:	16.5 MPa
Steam flow:	82 kg/s
Condenser backpressure:	10 kPa

¹³ Heath, G *et al* 2009, *Life cycle assessment of thermal energy storage: two-tank indirect and thermocline*, Conference Paper NREL/CP-6A2-45857 July 2009.

A model of the above configuration was created with Thermoflex Version 20 which is a thermodynamic modelling package by Thermoflow. Based on the model outcomes additional shell and tube heat exchangers were included to stage the pre-heating, superheating and reheating. To reduce vessel size parallel paths were used for the pre-heaters, evaporators and superheaters.

Although the original design criteria called for a condenser backpressure of 4.2 kPa (1.25 in Hg) it was found that the ACC would need to be significantly larger without appreciable performance benefit. Initial indications are that towards the lower end of possible backpressures, additional heliostats may be more cost effective than additional ACC cells as a strategy to increase net electrical output for a given steam condition, flow and turbine. As well as ACC size and cost increasing as backpressure required decreases, so to does the auxiliary energy required for ACC fans.

The Thermoflex library of heat transfer fluids includes the nitrate salt 60% NaNO₃/40% KNO₃ thus making correct modelling of heat transfer and heat exchanger design possible.

Thermoflex provides cost estimates for certain components including the turbine, shell and tube heat exchangers and ACC. The current version cost estimates are as of December 2009. In 2009 Aurecon compared Thermoflow GTPRO cost estimates against actual costs for two power plants built in Australia and found good correlation. The power plants were both gas fired, one open cycle and the other combined cycle.

A.3.6 Other project costs

In addition to the plant equipment costs described above, there are other costs that are not attributable to particular items of equipment, but are incurred by the owner during the period between project development to financial close and the period of construction. These costs or allowances include: contingency on high risk items, permits, licenses and fees, miscellaneous, bonds, insurance, legal & financial, escalation & interest during construction, project administration and developers' fee. For a solar thermal project, both engineering and development costs may be expected to be higher than for fossil plants (at least during the early stages of technology uptake). Land procurement is also a cost to the owner that must be considered. Based on GTPRO estimated owner costs for a combined cycle plant project, an allowance of 30% has been included for 'other project costs'.

A.4 Overall estimated capital cost

The methodology described above was used to determine the overall cost of the 100 MW plant with and without storage. A summary of the major plant area costs is provided in Table A.4.

Table A.4: Summary of capital costs for a 100 MW power tower plant

Equipment area	Unit Cost	Estimated cost (A\$ million)	
		No storage	With storage
Site preparation & civils	\$30 /kW _{e,net}	30.0	30.0
Solar Field	\$142 /m ²	101.8	143.2
Tower	\$29 /kW _{th}	11.5	14.5
Receiver	\$19 /kW _{th}	9.2	9.7
Molten Salt and Storage Systems	\$12 /kWh _{th}	12.6	20.8
Turbine systems (inc generator)	\$424 /kW _{e,gross}	46.0	46.6
Steam generation	\$187 /kW _{e,gross}	20.6	20.6
Air Cooled Condenser (ACC)	\$371 /kW _{e,gross}	40.8	40.8
Electrical	\$180 /kW _{e,net}	18.0	18.0
Controls	\$100 /kW _{e,net}	10.0	10.0
Fire Services	\$40 /kW _{e,net}	4.0	4.0
Spares (allow 5%)		15.2	17.9
Owner & contractor costs (30%)		95.9	112.9
Total		415.8	489.0

Impact of storage

The greatest impact of the addition of thermal energy storage on plant capital cost is with the solar field cost which increases by 40% with the addition of storage. The overall plant cost increase with thermal energy storage is 22%.

APPENDIX B: THERMODYNAMIC EXPLANATION OF RANKINE STEAM CYCLES

The Rankine cycle is illustrated in Figure B.1 and indicated on the included Mollier temperature-entropy (T-s) chart.

The main elements of the cycle include:

1. 1 - 2: Adiabatic pumping process (feedpump)
2. 2 – 3: Constant pressure heat transfer in the boiler. (Pt 3' is outside the saturation line as the steam is superheated.)
3. 3 – 4: Adiabatic expansion in the turbine
4. 4 – 1: Constant pressure transfer of heat in the condenser


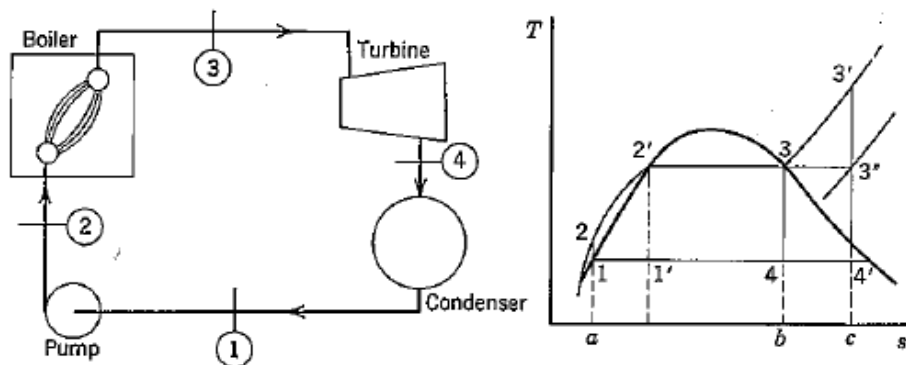


Figure B.1: Simple Rankine steam cycle power plant (Van Wylen & Sonntag, 1976)

The efficiency of the Rankine cycle depends on the average temperature at which heat is supplied and the average temperature at which heat is rejected. Any changes that increase the temperature that is supplied or decrease the average temperature that is rejected will increase the Rankine cycle efficiency.

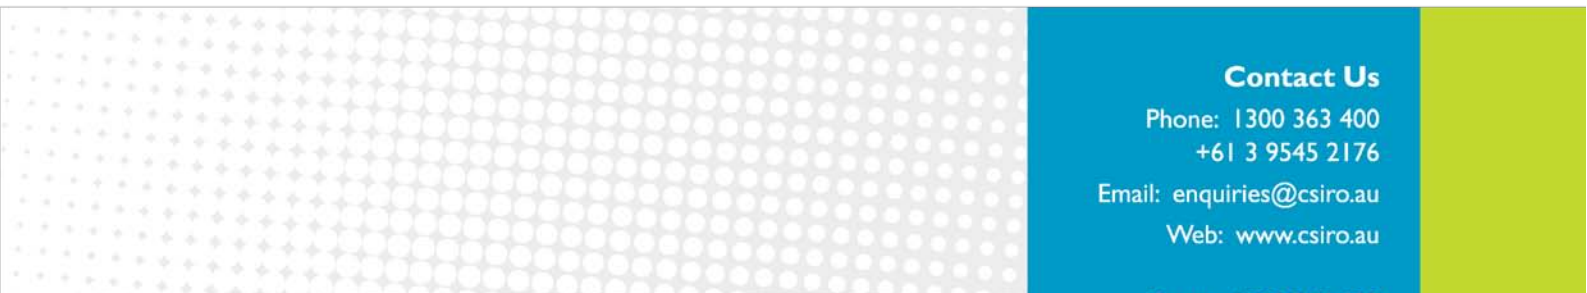

Contact Us

Phone: 1300 363 400

+61 3 9545 2176

Email: enquiries@csiro.au

Web: www.csiro.au

Your CSIRO

Australia is founding its future on science and innovation. Its national science agency, CSIRO, is a powerhouse of ideas, technologies and skills for building prosperity, growth, health and sustainability. It serves governments, industries, business and communities across the nation.